



This bulletin is to explain how to reset the counter for maintenance and ash-box full warning.

## 1. Change the User level to Service Mode

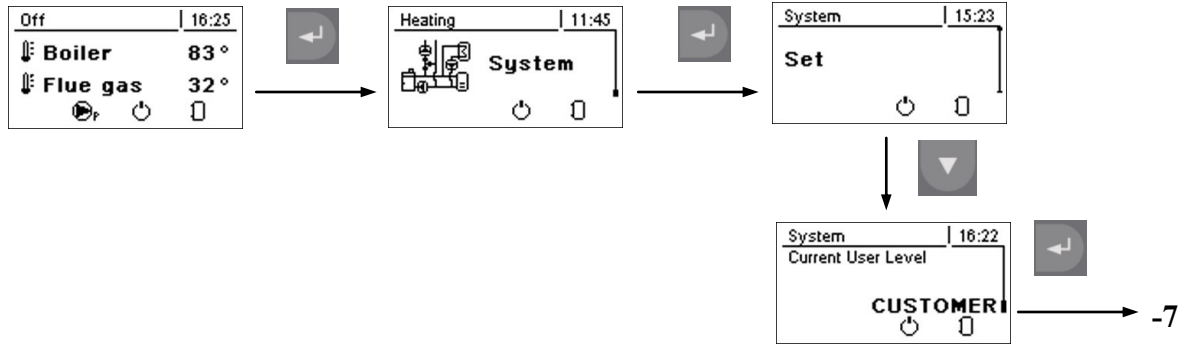

## 2. Reset the Maintenance Hours and Ashbox Warning

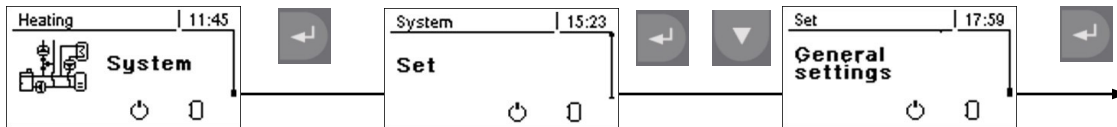

Parameter		Description
Adopt boiler standard values	NO	
Room air independent operation	NO	
Modem Installed	NO	
Memory cycle of data logger	5s	
Output warnings through fault message relays	NO	
Send a line break when ASCII data output on COM2	NO	
COM 2 is used as a MODBUS interface	NO	
MODBUS address	2	
MODBUS protocol (1-RTU/2-ASCII)	1	
Demoregler/Messesoftware Standardwerte übernehmen	NO	
Reset counter since last maintenance	NO	Changing to YES will reset Hours since last maintenance*
Remaining hours in heating mode till ashbox full warning appears	400h	
Reset counter of hours till ashbox full warning appears	NO	Changing to YES will reset ashbox full warning

\* This is tracked under Current values >Operation Hours >Hours since last maintenance